


PIER LOADINGS AT SECTIONAL CAPACITY	
PIER	LOADING
A	51.0 KIPS
B	56.0 KIPS
C	56.0 KIPS
D	51.0 KIPS

REVISION RECORD				
LTR	DESCRIPTION	DATE	ECO	BY
A	RELEASED FOR PRODUCTION	4/25/19	29562	PTS

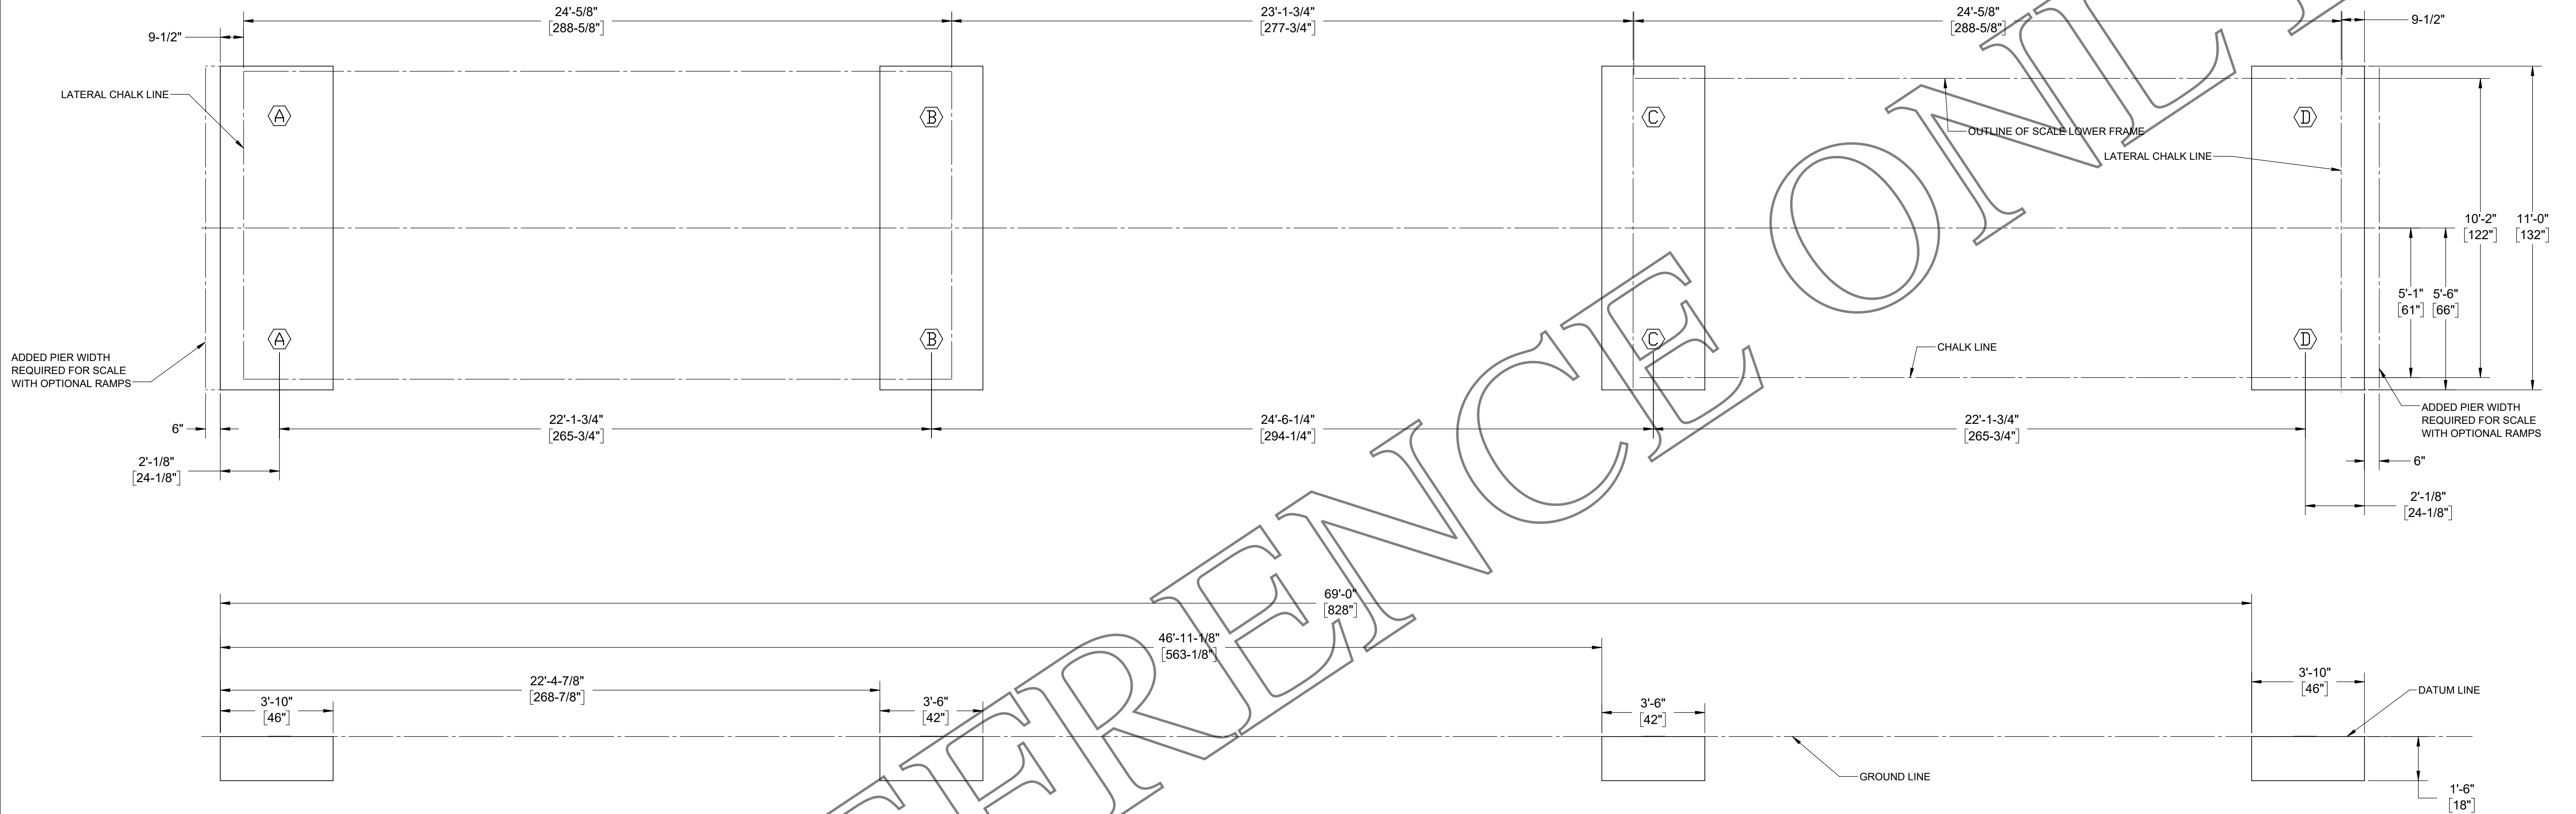

NOTES:

- THE SCALE PIER PLAN AS SHOWN IS SUFFICENT FOR FIRM SOIL AND GOOD CONCRETE. THE MINIMUM SOIL BEARING SHALL BE 4,000 POUNDS PER SQUARE FOOT AND THE MINIMUM CONCRETE STRENGTH SHALL BE 3,000 POUNDS PER SQUARE INCH, 28 DAY. FOR UNUSUAL SOIL CONDITIONS OR DEEP FROST PENETRATION, ALTER THE FOUNDATION AS REQUIRED. THE FOOTING SHALL BE BELOW THE FROST LINE.
- TOP OF PIERS SHALL BE IN A LEVEL PLANE AND A MINIMUM OF 4 INCHES ABOVE THE GROUND LINE. TOP OF PIERS ARE TO BE SMOOTH AND LEVEL WITHIN  $\pm 1/8"$ . (ALL PIERS ARE TO BE WITHIN  $1/4"$ .)
- A MINIMUM REINFORCING SCHEDULE OF #4 RODS ON 6 INCH CENTERS SHALL EXTEND THE ENTIRE WIDTH OF THE PIERS. REINFORCING RODS SHALL BE PLACED 3 INCHES FROM THE TOP AND BOTTOM OF SURFACE OF THE PIERS. REINFORCING ROD ARE NOT FURNISHED BY CARDINAL SCALE MFG. CO. THE REBAR SHALL CONFORM TO ASTM A-185.
- THE CONTRACTOR SHALL CONTACT THE STATE WEIGHTS AND MEASURES DIVISION FOR STATE FOUNDATION REQUIREMENTS (SOME STATES REQUIRE SPECIAL PIER DEPTHS.)
- CARDINAL SCALE MFG. CO. SHALL NOT BE RESPONSIBLE FOR THE STABILITY OF THE PIERS.
- APPROXIMATELY 8.9 CUBIC YARDS OF CONCRETE REQUIRED.
- ON THE APPROACH END OR ENDS OF A VEHICLE SCALE INSTALLED IN ANY ONE LOCATION FOR A PERIOD OF SIX MONTHS OR MORE, THERE SHALL BE A STRAIGHT AND LEVEL APPROACH AS FOLLOWS:
  - AT LEAST THE WIDTH OF THE PLATFORM AND
  - AT LEAST ONE-HALF THE LENGTH OF THE PLATFORM BUT NOT REQUIRED TO BE MORE THAN 40 FEET, AND
  - NOT LESS THAN 10 FEET OF ANY APPROACH ADJACENT TO THE PLATFORM SHALL BE CONSTRUCTED OF CONCRETE OR SIMILAR DURABLE MATERIAL TO INSURE THAT THIS PORTION REMAINS SMOOTH AND LEVEL AND IN THE SAME PLANE AS THE PLATFORM. HOWEVER, GRATING OF SUFFICENT STRENGTH TO WITHSTAND ALL LOADS MAY BE INSTALLED IN THIS PORTION; AND FURTHER WHERE DEEMED NECESSARY FOR DRAINAGE PURPOSES, THE REMAINING PORTION OF THE APPROACH MAY SLOPE SLIGHTLY.
- CONSTRUCT CHALK LINES AS SHOWN BEFORE PLACING THE SCALE.
- FOR NON-SNAP APPLICATIONS: THE INDICATOR CABLE SHOULD BE INSTALLED IN A PROTECTIVE 1 1/2" MINIMUM SIZE CONDUIT OR COVER. THE CABLE MUST BE A MINIMUM OF 24" FROM ALL A.C. ELECTRICAL LINES. (THEY MAY CROSS AT 90° ONLY.) CONDUIT NOT SUPPLIED BY CARDINAL SCALE MFG. CO.

TOLERANCE ON DIMENSIONS ARE:				DO NOT SCALE DRAWING		PARENT MODEL	
ANGLES		± 1/2"		DR. PHIL	DATE 4/24/2019	CH.	DATE
INTEGERS/FRACTIONS		± 1/16 IN.		D SHEET 1 OF 1			
DECIMALS (X)		± .03 IN.		DWG. NO. 0330-1332-0A			
DECIMALS (XX)		± .01 IN.		REV. A			
DECIMALS (XXX)		± .005 IN.					
DECIMALS (XXXX)		± .0005 IN.					
NOTE: WHOLE NUMBERS MUST BE WRITTEN XX,000 TO INVOKE DECIMAL TOLERANCES.							
THIS DRAWING IS THE PROPERTY OF THE CARDINAL SCALE MFG. CO. AND SHALL NOT BE USED NOR REPRODUCED EITHER WHOLLY OR IN PART EXCEPT WITH WRITTEN AUTHORIZATION. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.							